



## Technical Precautions for Design, Installation and Maintenance

### 34) External Connection Diagrams for Standard Motorized Pulleys


#### Standard Terminal Box 0.5 HP - 330 HP

Diagrams are valid for Motorized Pulleys manufactured after January 2011. For units built prior to this date contact Rulmecca or refer to Repair and Maintenance Guide available at [www.rulmecacorp.com](http://www.rulmecacorp.com).

T1 & T2 = Internal bi-metallic thermal protection switch which **MUST BE CONNECTED** to external normally closed control circuit.

See Technical Precautions pages 78 - 88 for complete electrical design, installation, and maintenance instructions.

USA standard 460V power supply

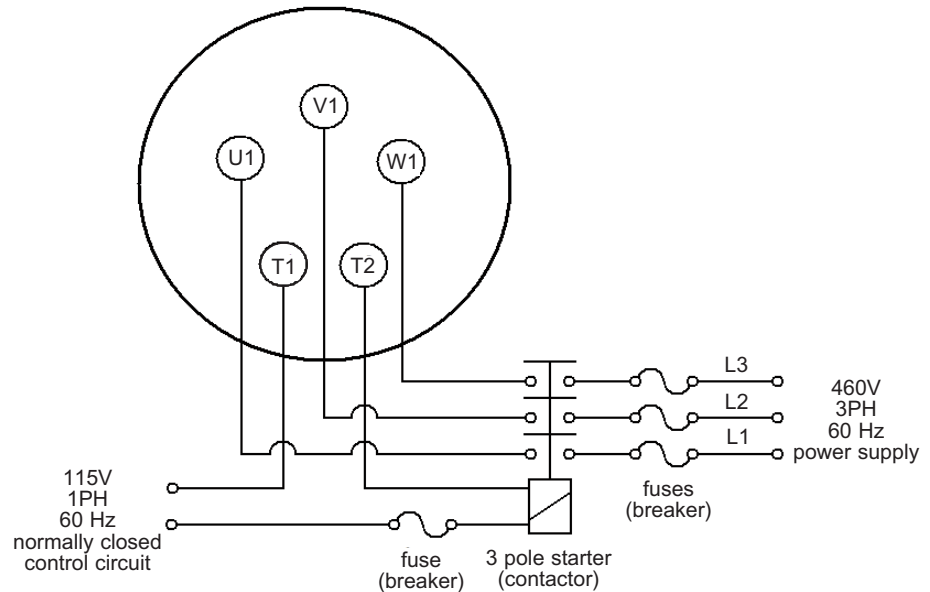

USA standard 230V power supply

